


Unit Ratings


		60Hz
Standby:	kW/kva	210
Prime:	kW/kva	189

Alternator Ratings at 1.0 Power Factor

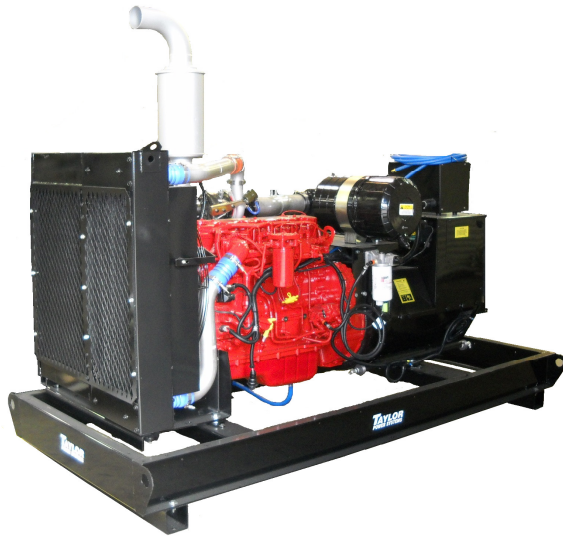

Features

- Single source responsibility for the generator set and accessories.
- Prototype and production tested to insure one step load acceptance per NFPA 110.
- Two year limited warranty on generator sets and accessories.
- Unit conforms to CSA, NEMA, EGSA, ANSI and other standards.
- Heavy duty 4 cycle industrial engine for reliability and fuel efficiency.
- Brushless rotating field generator with class H insulation.
- Heavy duty steel base with integral vibration isolators.
- Analog Control system with an ECU-CAN76 providing metering and monitoring.
- EPA Tier 3 Certified Engine.


	Cummins Inc. Columbus, Indiana 47202-3005 Engine Data Sheet	Basic Engine Model: QSB7-G5 NR3	Curve Number: FR-92278	G-DRIVE QSB 1
		Engine Critical Parts List: CPL: 42605	Date: 12Dec07	

Displacement : 6.69 litre (408 in³)	Bore : 107 mm (4.21 in.) Stroke : 124 mm (4.88 in.)
No. of Cylinders : 6	Aspiration : Turbocharged and Air to Air Aftercooled

Engine Speed rpm	Standby Power		Prime Power		Continuous Power	
	kWm	hp	kWm	hp	kWm	hp
1500	213	285	182	244	152	204
1800	242	324	208	279	164	220


Engine Performance Data @ 1500 rpm

OUTPUT POWER			FUEL CONSUMPTION			
%	kWm	hp	kg/ kWm·h	lb/ hp·h	litre/ hour	US gal/ hour
STANDBY POWER						
100	213	285	0.203	0.334	51	13.4
PRIME POWER						
100	182	244	0.210	0.346	45	11.9
75	137	183	0.223	0.367	36	9.5
50	91	122	0.246	0.404	26	6.9
25	46	61	0.240	0.394	13	3.4
CONTINUOUS POWER						
100	152	204	0.221	0.364	40	10.5

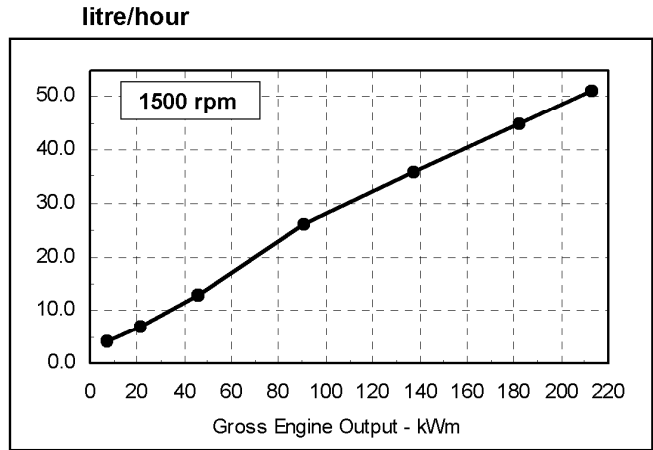

Engine Performance Data @ 1800 rpm

OUTPUT POWER			FUEL CONSUMPTION			
%	kWm	hp	kg/ kWm·h	lb/ hp·h	litre/ hour	US gal/ hour
STANDBY POWER						
100	242	324	0.206	0.339	59	15.5
PRIME POWER						
100	208	279	0.206	0.339	50	13.3
75	156	209	0.219	0.360	40	10.6
50	104	140	0.242	0.398	30	7.8
25	52	70	0.245	0.404	15	4.0
CONTINUOUS POWER						
100	164	220	0.216	0.355	42	11.0

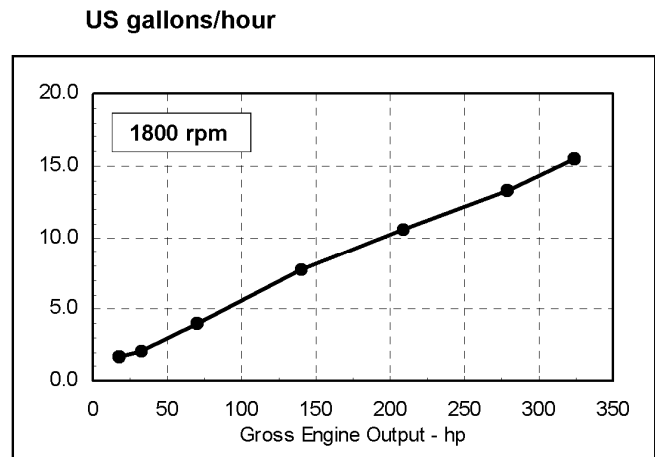

CONVERSIONS: (litres = US Gal x 3.785) (US Gal = litres x 0.2642)

Data Subject to Change Without Notice

These guidelines have been formulated to ensure proper application of generator drive engines in A.C. generator set installations. **STANDBY POWER RATING:** Applicable for supplying emergency power for the duration of the utility power outage. No overload capability is available for this rating. Under no condition is an engine allowed to operate in parallel with the public utility at the Standby Power rating. This rating should be applied where reliable utility power is available. A Standby rated engine should be sized for a maximum of an 80% average load factor and 200 hours of operation per year. This includes less than 25 hours per year at the Standby Power rating. Standby ratings should never be applied except in true emergency power outages. Negotiated power outages contracted with a utility company are not considered an emergency. **PRIME POWER RATING:** Applicable for supplying electric power in lieu of commercially purchased power. Prime Power applications must be in the form of one of the following two categories **UNLIMITED TIME RUNNING PRIME POWER:** Prime Power is available for an unlimited number of hours per year in a variable load application. Variable load should not exceed a 70% average of the Prime Power rating during any operating period of 250 hours. The total operating time at 100% Prime Power shall not exceed 500 hours per year. A 10% overload capability is available for a period of 1 hour within a 12-hour period of operation. Total operating time at the 10% overload power shall not exceed 25 hours per year. **LIMITED TIME RUNNING PRIME POWER:** Limited Time Prime Power is available for a limited number of hours in a non-variable load application. It is intended for use in situations where power outages are contracted, such as in utility power curtailment. Engines may be operated in parallel to the public utility up to 750 hours per year at power levels never to exceed the Prime Power rating. The customer should be aware, however, that the life of any engine will be reduced by this constant high load operation. Any operation exceeding 750 hours per year at the Prime Power rating should use the Continuous Power rating. **CONTINUOUS POWER RATING:** Applicable for supplying utility power at a constant 100% load for an unlimited number of hours per year. No overload capability is available for this rating.

Reference AEB 10.47 for determining Electrical Output.

Data shown above represent gross engine performance capabilities obtained and corrected in accordance with ISO-3046 conditions of 100 kPa (29.53 in Hg) barometric pressure [110 m (361 ft) altitude], 25 °C (77 °F) air inlet temperature, and relative humidity of 30% with No. 2 diesel or a fuel corresponding to ASTM D2. Derates shown are based on 15 in H₂O air intake restriction and 2 in Hg exhaust back pressure.

The fuel consumption data is based on No. 2 diesel fuel weight at 0.85 kg/litre (7.1 lbs/US gal). Power output curves are based on the engine operating with fuel system, water pump and lubricating oil pump; not included are battery charging alternator, fan, optional equipment and driven components.

Data Status: --Limited-Production--




Data Tolerance: ± 5%

Chief Engineer:






QSB7-G5 NR3

1500 rpm Derate Curves

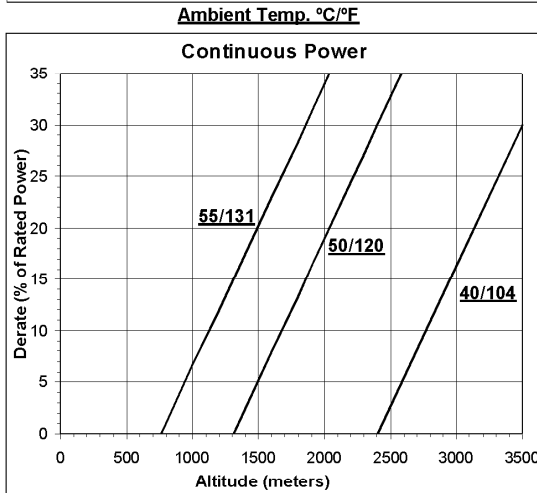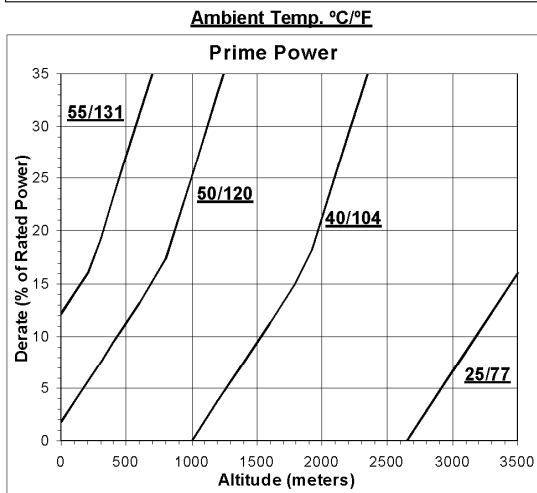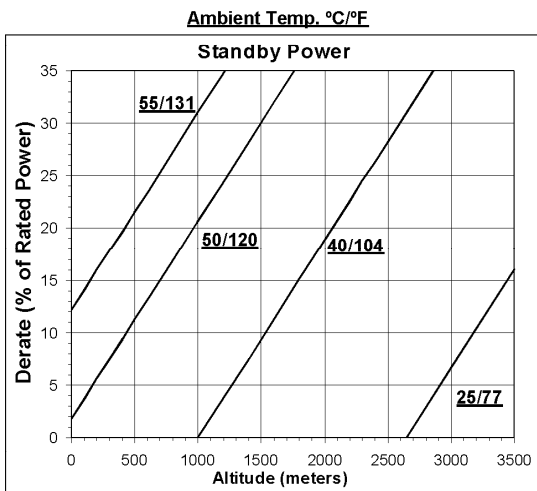

1800 rpm Derate Curves

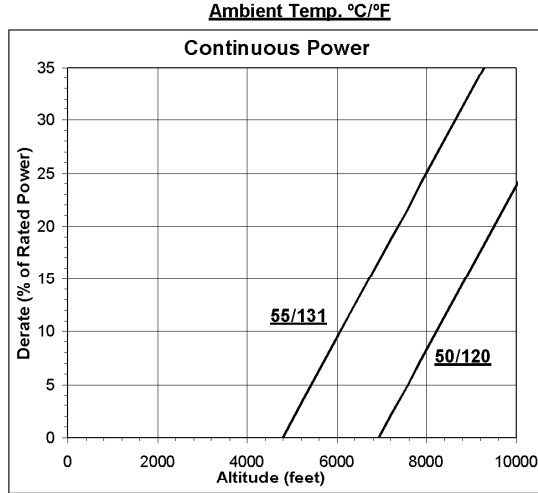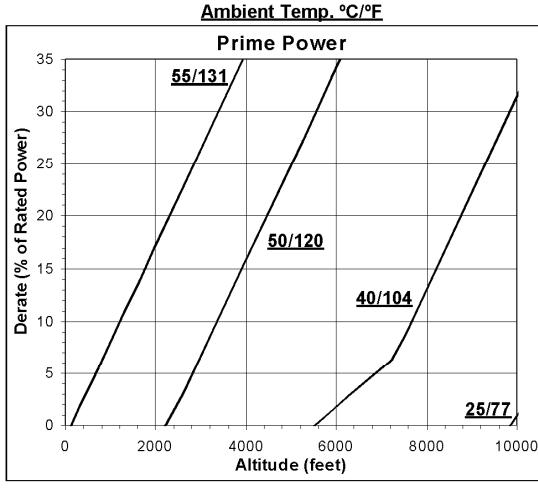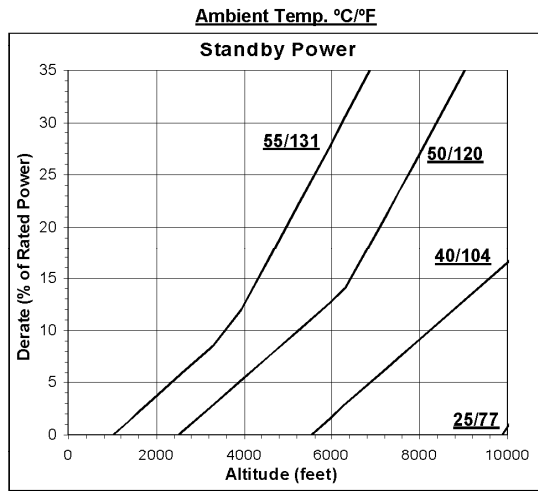

Operation At Elevated Temperature And Altitude:

For **Standby Operation** above these conditions, derate by an additional 6% per 300 m (1000 ft), and 21% per 10° C (18° F).
 For **Prime Operation** above these conditions, derate by an additional 12% per 300 m (1000 ft), and 43% per 10° C (18° F).
 For **Continuous Operation** above these conditions, derate by an additional 8% per 300 m (1000 ft), and 30% per 10° C (18° F).

Operation At Elevated Temperature And Altitude:

For **Standby Operation** above these conditions, derate by an additional 8% per 300 m (1000 ft), and 34% per 10° C (18° F).
 For **Prime Operation** above these conditions, derate by an additional 9% per 300 m (1000 ft), and 40% per 10° C (18° F).
 For **Continuous Operation** above these conditions, derate by an additional 8% per 300 m (1000 ft), and 34% per 10° C (18° F).

Cummins Inc.
Engine Data Sheet

ENGINE MODEL : **QSB7-G5 NR3** CONFIGURATION NUMBER : D313007GX03

DATA SHEET : DS-92278

DATE : 12Dec07

PERFORMANCE CURVE : FR-92278

INSTALLATION DIAGRAM

• Fan to Flywheel:

CPL NUMBER

• Engine Critical Parts List: 42605

GENERAL ENGINE DATA

Type	4-Cycle; In-line; 6-Cylinder Diesel
Aspiration	Turbocharged and Charge Air Cooled
Bore x Stroke	4.21 x 4.88 (107 x 124)
Displacement.....	408 (6.69)
Compression Ratio.....	17.2 : 1
Dry Weight (Approximate), Fan to Flywheel Engine.....	1047 (475)
Wet Weight (Approximate), Fan to Flywheel Engine.....	1069 (485)
Moment of Inertia of Rotating Components	
• with FW 9857 Flywheel	24.7 (1.55)
• with FW 9878 Flywheel.....	36.8 (2.47)
Center of Gravity from Rear Face of Block.....	13.7 (348)
Center of Gravity Above Crankshaft Centerline	5.91 (150)
Maximum Static Loading at Rear Main Bearing.....	N/A (N/A)

ENGINE MOUNTING

Maximum Bending Moment at Rear Face of Block	1000 (1356)
--	-------------

EXHAUST SYSTEM

Maximum Back Pressure.....	3 (10.2)
----------------------------	----------

AIR INDUCTION SYSTEM

Maximum Intake Air Restriction	
• with Dirty Filter Element.....	25 (6.2)
• with Clean Filter Element.....	15 (3.7)

COOLING SYSTEM

Jacket Water Circuit Requirements

Coolant Capacity — Engine Only	2.7 (10.2)
Maximum Static Head of Coolant Above Engine Crank Centerline	60 (18.3)
Standard Thermostat (Modulating) Range	175-203 (79-95)
Minimum Pressure Cap.....	15 (103)
Maximum Top Tank Temperature for Standby / Prime Power	233/225 (112/107)
Maximum Coolant Friction Head External to Engine	5 (35)

Charge Air Cooler Requirements

Maximum Temp. Rise Between Engine Air Intake and Intake Manifold - 1500/1800 rpm	45 (25)
Maximum Air Pressure Drop from Turbo Air outlet to Intake Manifold - 1500/1800 rpm .	2.5/4 (8.5/13.5)
Maximum Intake Manifold Temperature @ 77 °F (25 °C) ambient - 1500/1800 rpm	122 (50)
Maximum Intake Manifold Temperature for engine protection (Shut Down Threshold)	203 (95)

LUBRICATION SYSTEM

Oil Pressure @ Idle Speed.....	10 (69)
@ Governed Speed	40-60 (276-414)
Maximum Oil Temperature	280 (138)
Oil Capacity with OP 9457 Oil Pan : Low - High.....	4.0-4.6 (15.1-17.4)
Total System Capacity (Including Filter)	5.0 (18.9)

FUEL SYSTEM

Type Injection System	Bosch HPCR	
Maximum Restriction at Lift Pump (clean/dirty filter)..... — in Hg (kPa)	5/10 (17/34)	
Maximum Allowable Head on Injector Return Line (Consisting of Friction Head and Static Head) — in Hg (kPa)	6	(20)
Maximum Fuel Flow to Injector Pump	28	(106)
Maximum Return Fuel Flow	27	(103)
Maximum Fuel Inlet Temperature	160	(71)

ELECTRICAL SYSTEM

Cranking Motor (Heavy Duty, Positive Engagement)	— volt	12	24
Battery Charging System, Negative Ground	— ampere	100	70
Maximum Allowable Resistance of Cranking Circuit	— ohm	0.001	0.002
Minimum Recommended Battery Capacity			
• Cold Soak @ 0 °F to 32 °F (-18 °C to 0 °C)	— 0°F CCA	1100	(550)

COLD START CAPABILITY

Minimum Ambient Temperature for NFPA 110 Cold Start (90 degree F Coolant Temperature)	— °F (°C)	40	(4)
Minimum Ambient Temperature for Unaided Cold Start	— °F (°C)	10	(-12)

PERFORMANCE DATA

- All data is based on:
- Engine operating with fuel system, water pump, lubricating oil pump, air cleaner and exhaust silencer; not included are battery charging alternator, fan, and optional driven components.
 - Engine operating with fuel corresponding to grade No. 2-D per ASTM D975.
 - ISO 3046, Part 1, Standard Reference Conditions of:
 - Barometric Pressure : 100 kPa (29.53 in Hg) Air Temperature : 25 °C (77 °F)
 - Altitude : 110 m (361 ft) Relative Humidity : 30%

Steady State Stability Band at Any Constant Load	— %	+/-	0.25
Estimated Free Field Sound Pressure Level of a Typical Generator Set;			
Excludes Exhaust Noise; at Rated Load and 7.5 m (24.6 ft); @1800 rpm	— dBA		88
Exhaust Noise at 1 m Horizontal from Centerline of Exhaust Pipe Outlet Upwards at 45 °	— dBA		95.2

	STANDBY POWER		PRIME POWER	
	60 hz	50 hz	60 hz	50 hz
Governed Engine Speed	1800	1500	1800	1500
Engine Idle Speed	700 - 900	700 - 900	700 - 900	700 - 900
Gross Engine Power Output.....	324 (242)	285 (213)	279 (208)	244 (182)
Brake Mean Effective Pressure	349 (2404)	368 (2537)	300 (2070)	315 (2172)
Piston Speed	1464 (7.4)	1220 (6.2)	1464 (7.4)	1220 (6.2)
Friction Horsepower	25 (19)	19 (14)	25 (19)	19 (14)
Engine Water Flow at Stated Friction Head External to Engine:				
• 2.5 psi Friction Head	38 (2.4)	32 (2.0)	38 (2.4)	32 (2.0)
• Maximum Friction Head	33 (2.1)	26 (1.6)	33 (2.1)	26 (1.6)
Engine Data				
Intake Air Flow	569 (269)	448 (212)	541 (256)	434 (205)
Exhaust Gas Temperature	988 (532)	1041 (561)	907 (487)	1011 (544)
Exhaust Gas Flow	1549 (732)	1265 (597)	1342 (634)	1205 (569)
Air to Fuel Ratio	22.6:1	20.6:1	25.1:1	22.5:1
Radiated Heat to Ambient	1342 (24)	1163 (21)	1154 (21)	1032 (19)
Heat Rejection to Jacket Coolant.....	4858 (86)	4475 (79)	4231 (75)	3932 (70)
Heat Rejection to Exhaust	10734 (189)	9261 (163)	9078 (160)	8542 (151)
Heat Rejected to Fuel	52 (1)	44 (1)	39 (1)	32 (1)
Heat Rejected to Aftercooler.....	2786 (49)	2041 (36)	2499 (44)	1893 (34)
Charge Air Flow	42 (19)	33 (15)	39 (18)	32 (15)
Turbocharger Compressor Outlet Pressure	35 (239)	31 (214)	32 (219)	29 (199)
Turbocharger Compressor Outlet Temperature.....	399 (204)	379 (193)	376 (192)	363 (184)

N.A. - Not Available
 N/A - Not Applicable to this Engine
 TBD - To Be Determined

ENGINE MODEL : **QSB7-G5 NR3**
 DATA SHEET : DS-92278
 DATE : 12Dec07
 CURVE NO. : FR-92278

Generator Controller



Analog Top Mount Controller

This Generator control panel has analog instruments to monitor AC voltage, AC frequency, percent of load and, run time/hour meter. Safety shutdowns provide red LED indication for overspeed, overcrank, low oil pressure, and high coolant temperature. Provide green LED indication of engine running. Control switch is provided for local and remote starting with 3 position run/off/remote switch.

There is also an engine mounted emergency by-pass key switch with mechanical oil pressure and coolant temperature gauge.

AC Alternator Specifications

Taylor Power Systems uses Full Output Rated 4 Lead design Single Phase Generators, which provide superior motor starting, and generator efficiency.

STANDARDS

Stamford industrial generators meet the requirements of BS EN 60034 and the relevant section of other international standards such as B55000, VDE 0530, NEMA MG1-32, 1EC34, CSA C22.2-100, A51359.

Other standards and certifications can be considered on request.

VOLTAGE REGULATORS

MX341 AVR

This sophisticated AVR is incorporated into the Stamford Permanent Magnet Generator (PMG) control system.

The PMG provides power via the AVR to the main exciter, giving a source of constant excitation power independent of generator output. The main exciter output is then fed to the main rotor, through a full wave bridge, protected by a surge suppressor. The AVR has in-built protection against sustained over-excitation, caused by internal or external faults. This de-excites the machine after a minimum of 5 seconds.

An engine relief load acceptance feature can enable full load to be applied to the generator in a single step.

If three-phase sensing is required with the PMG system the MX321 AVR must be used.

We recommend three-phase sensing for applications with greatly unbalanced or highly non-linear loads.

(Optional) MX321 AVR

The most sophisticated of all our AVRs combines all the features of the MX341 with, additionally, three-phase rms sensing, for improved regulation and performance. Over voltage protection is built-in and short circuit current level adjustments is an optional facility.

WINDINGS & ELECTRICAL PERFORMANCE

All generator stators are wound to 2/3 pitch. This eliminates triplen (3rd, 9th, 15th ...) harmonics on the voltage waveform and is found to be the optimum design for trouble-free supply of non-linear loads. The 2/3 pitch design avoids excessive neutral currents sometimes seen with higher winding pitches, when in parallel with the mains. A frilly connected damper winding reduces oscillations during paralleling. This winding, with the 2/3 pitch and carefully selected pole and tooth designs, ensures very low waveform distortion.

SHAFT

The generator rotor is dynamically balanced to better than B56861:Part 1 Grade 2.5 for minimum vibration in operation.

INSULATION/IMPREGNATION

The insulation system is class H.

All wound components are impregnated with materials and processes designed specifically to provide the high build required for static windings and the high mechanical strength required for rotating components.

QUALITY ASSURANCE

Generators are manufactured using production procedures having a quality assurance level to BS EN ISO 9001.

Standard Features and Optional Accessories

Standard Features

- **Heavy duty steel base**
- **Vibration isolators**
- **Battery**
- **Battery rack**
- **Battery cables**
- **Battery Charger**
- **Spark arresting muffler**
- **Flexible fuel lines**
- **PMG Exciter**
- **Water jacket heater**
- **Electronic Isochronous Governor**
- **Owners manual**


Optional Accessories

- Exhaust Silencer
- Sub-Base Fuel Tank
- Above ground fuel tank
- Oil pan heater
- Battery heater
- Generator strip heater
- Line circuit breaker
- Automatic transfer switch
- Elevated base

WEIGHTS AND DIMENSIONS

OVERALL SIZE, L x W x H, in.: 108 in. x 46 in. x 54 in.
WEIGHT (WET): 3,600 lbs.

Note: Dim and weights reflect standard open unit with no options

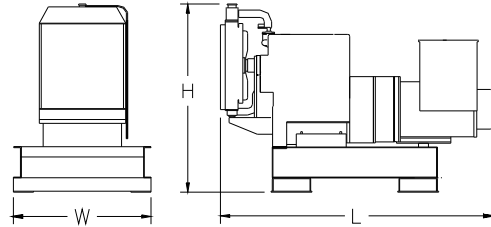

Note: This drawing is provided for reference only and should not be used for planning installation. Contact your local distributor for more detailed information.

DISTRIBUTED BY:

TAYLOR
POWER SYSTEMS

461 Hwy. 49S
Richland, Mississippi 39218
Phone (601)-932-5674
Toll Free 1-800-367-7639
Fax (601)-932-4028
Web Site www.taylorpower.com